


제품 사양서

품 명 및 규 격	수량	설치장소(설치수량)
Water-Air 복합 성능평가용 실험구	1	실기실 201c호 (환경생태 수자원 실험실)

번호	품명	규격	수량	비고
1	판넬공사(방진코팅)	폴리우레탄 80T	70	화스너타입
2	Over LAB DOOR (비규격)	1266*2066	1	장비반입구
3	BASE FRAME(아연도각관)	75*45	1	바닥수평
4	에폭시 라이너 도장	-	1	바닥코팅
5	BLOWER	1HP	2	
6	덕트제작(급배기)			
7	HEPA FILTER BOX	350*350*75	2	필터포함
8	환기제어시스템	-	1	컨트롤러
9	외부 내부 기기간선공사	LED전등 + 전열콘센트	1	전기설비
10	냉난방기 이설 설치	-	1	
11	철거 및 벽체 타공	-	1	
12	운송비 공과잡비	-	1	


*도면 별첨

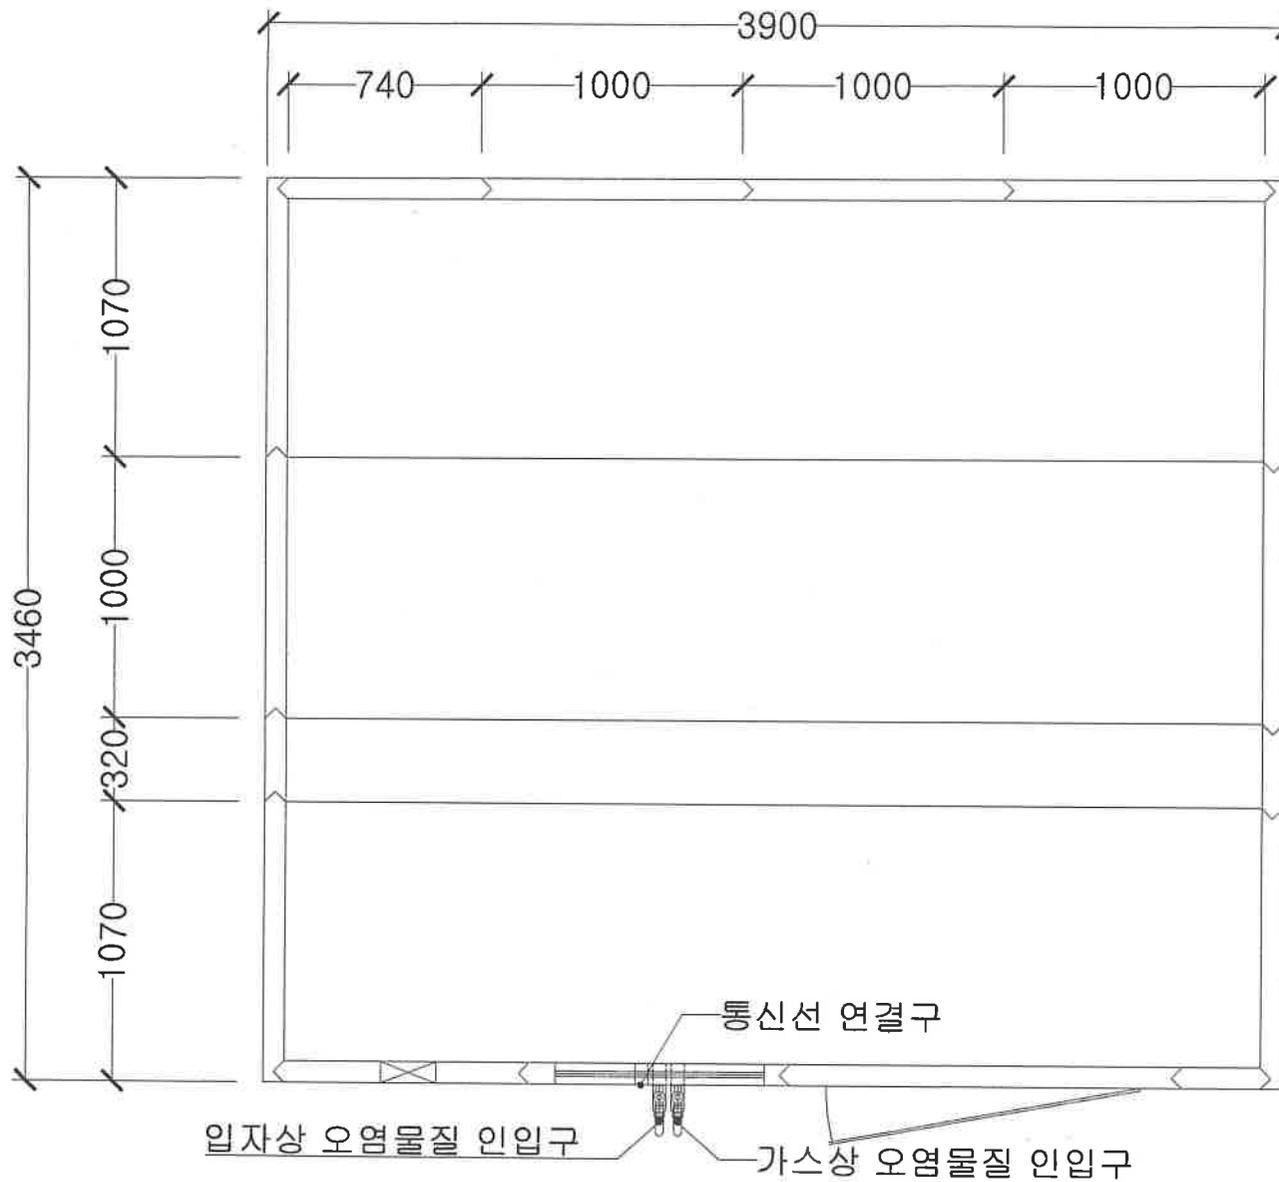

Korea Scientific Technique
Industry Co., Ltd.
TEL : +82-31-291-4055
FAX : +82-31-291-4066
EMAIL : gaooze@hanmail.net
HOMEPAGE : www.gaooze.com

DRAWING BY	주식회사 한국과기산업	DATE	2020. 04.
CHECKED BY	-	DRAWING NO.	-
APPROVED BY	-	SHEET NO.	-

SCALE	A3 = 1/20
DRAWING TITLE	상명대학교바이오필터성능평가실 판넬평면도

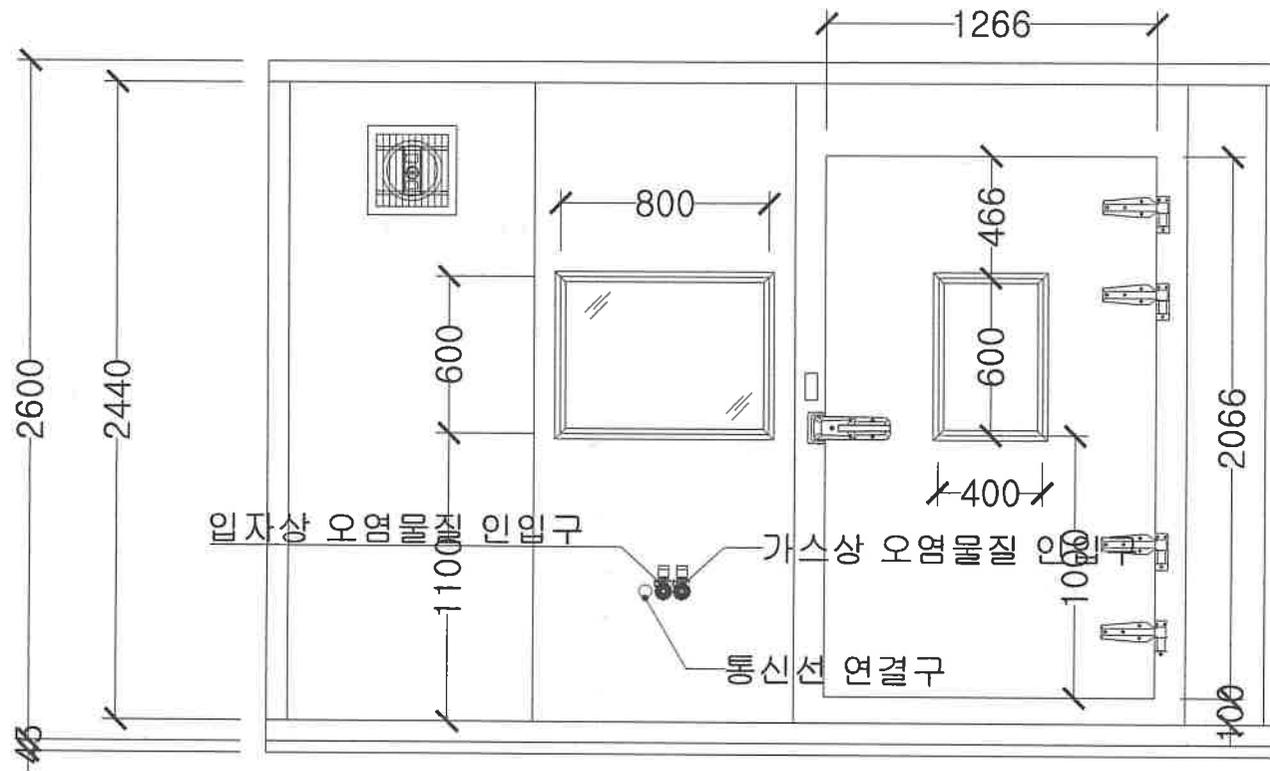


Korea Scientific Technique
 Industry Co., Ltd.
 TEL : +82-31-291-4055
 FAX : +82-31-291-4066
 EMAIL : gaooze@hanmail.net
 HOMEPAGE : www.gaooze.com

DRAWING BY	주식회사 한국과기산업
CHECKED BY	-
APPROVED BY	-

DATE	2020. 04.
DRAWING NO.	-
SHEET NO.	-

SCALE	A3 = 1/20
DRAWING TITLE	상명대학교바이오필터성능평가실 판넬단면도

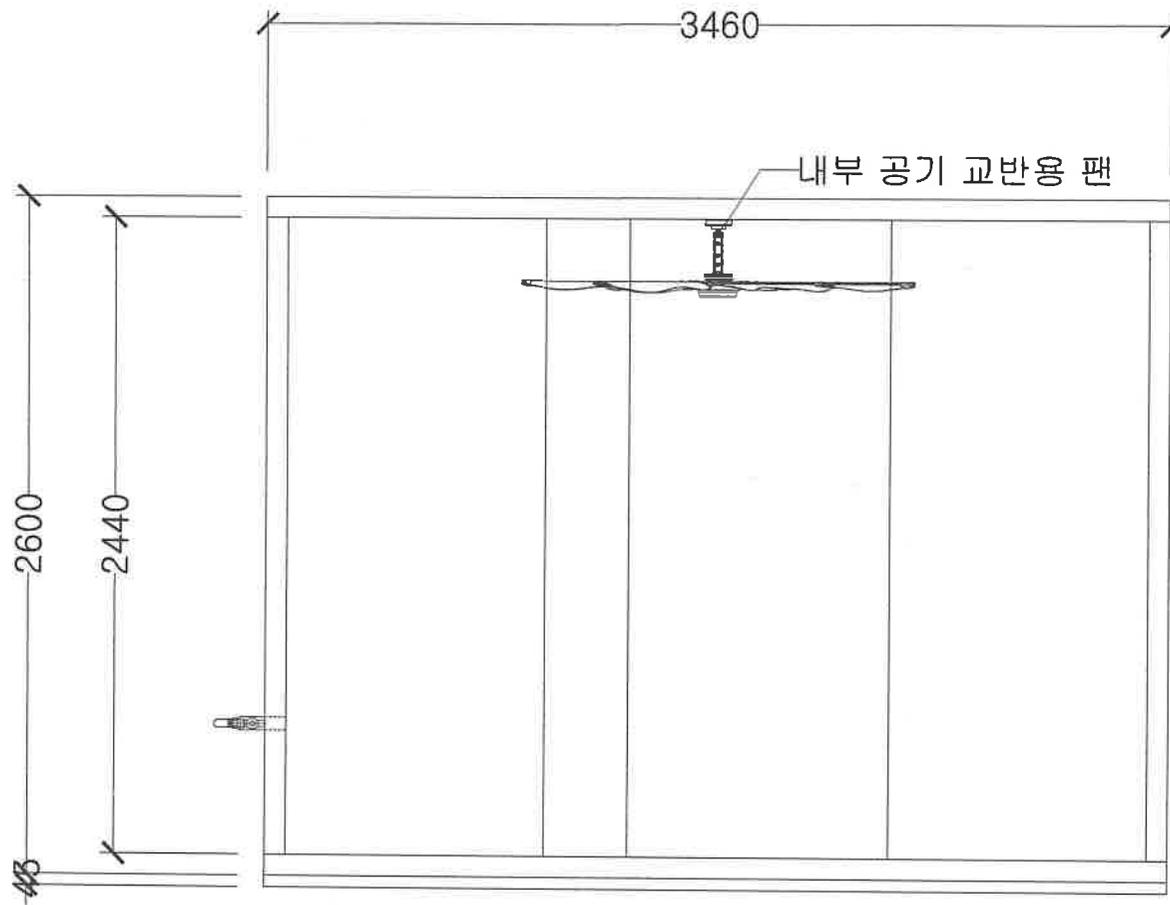

- ** THICK : 80T
- ** SKIN : C705 + C705
- ** DOOR SIZE : 1266 X 2066H
- ** OPEN SIZE : 1200 X 2000H
- ** HEATER 있음
- ** 문턱 : 133m/m (WALK IN TYPE)




Korea Scientific Technlque
Industry Co., Ltd.
TEL : +82-31-291-4055
FAX : +82-31-291-4066
EMAIL : gooze@hanmail.net
HOMEPAGE : www.gooze.com

DRAWING BY	주식회사 한국과기산업	DATE	2020. 04.	SCALE	A3 = 1/20
CHECKED BY	-	DRAWING NO.	-	DRAWING TITLE 상명대학교바이오필터성능평가실 관별단면도	
APPROVED BY	-	SHEET NO.	-		


장비개요

기호	품명	수량
AC 1	냉난방기(이설)	1EA
CDU 1	냉난방기실외기(이설)	1EA
BL 1	환기용 BLOWER	2EA
HF 1	HEPA FILTER BOX	2EA
VC 1	환기콘트롤러	1EA

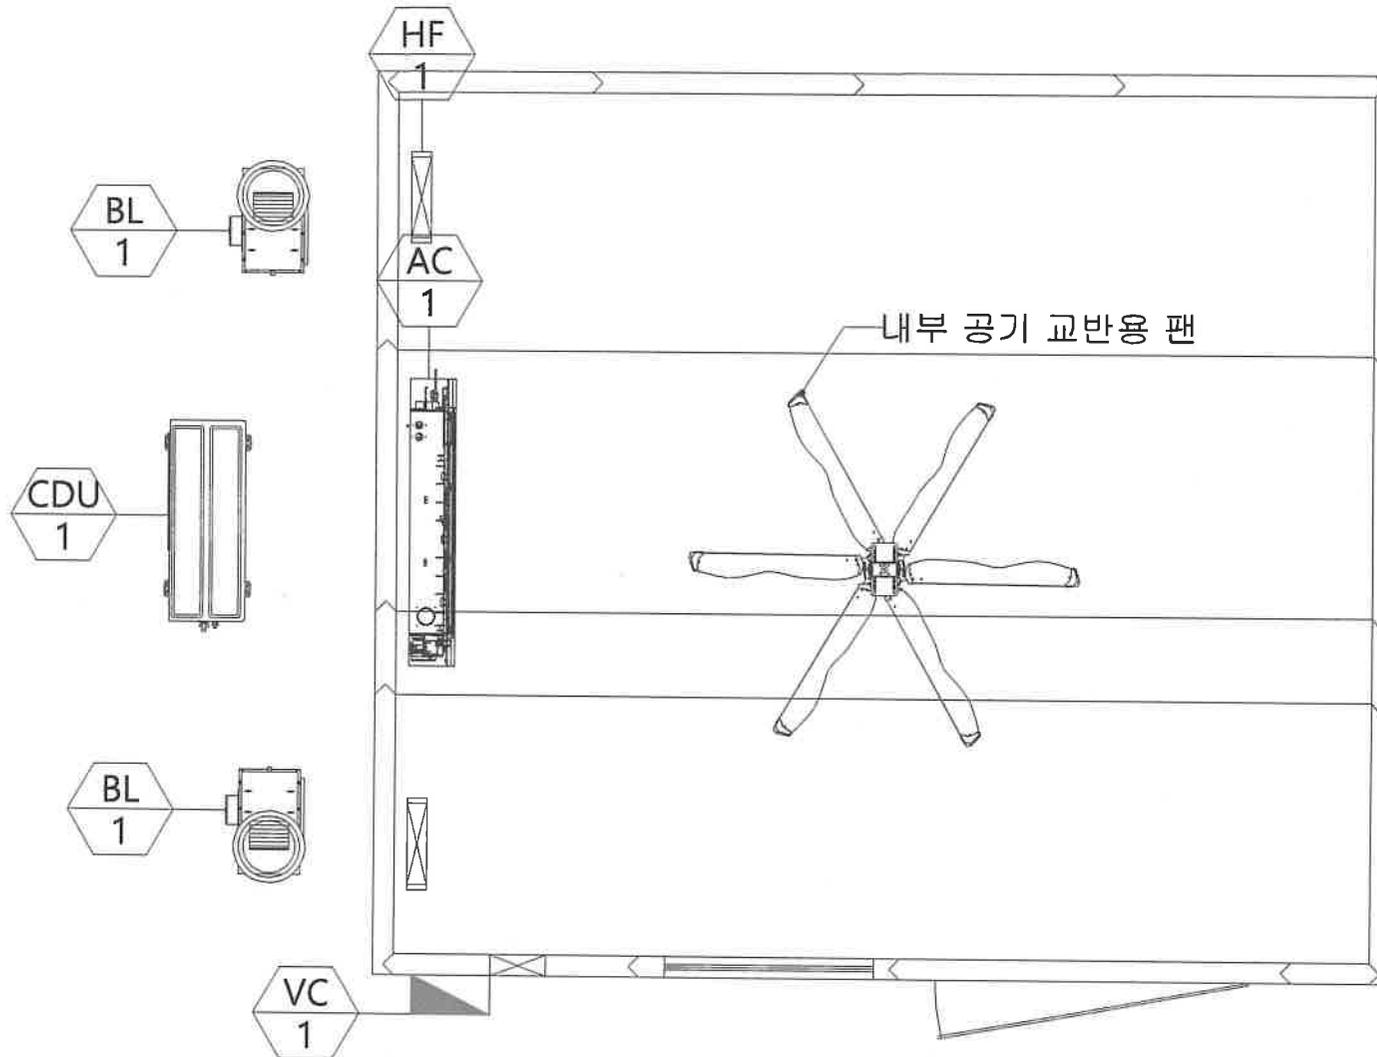


Korea Scientific Technique
Industry Co., Ltd.
TEL : +82-31-291-4055
FAX : +82-31-291-4066
EMAIL : gaooze@hanmail.net
HOMEPAGE : www.gaooze.com

DRAWING BY	주식회사 한국과기산업	DATE	2020. 04.	SCALE	A3 = 1/20
CHECKED BY	-	DRAWING NO.	-	DRAWING TITLE 상명대학교바이오필터성능평가실 장비배치도	
APPROVED BY	-	SHEET NO.	-		

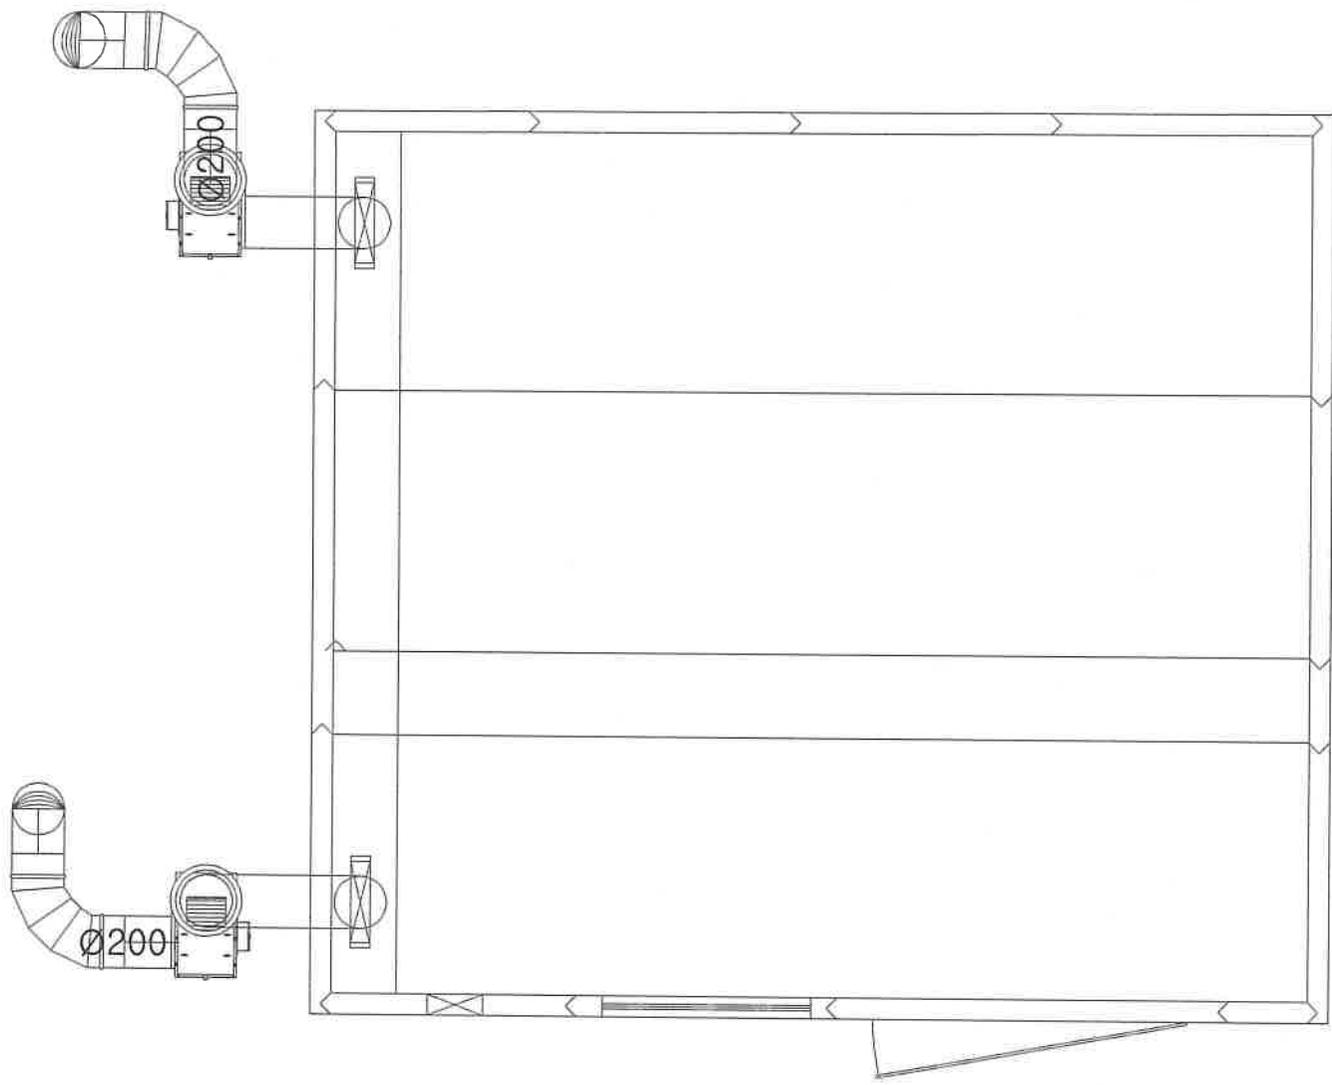


Korea Scientific Technique
Industry Co., Ltd.
TEL : +82-31-291-4055
FAX : +82-31-291-4066
EMAIL : gaooze@hanmail.net
HOMEPAGE : www.gaooze.com

DRAWING BY	주식회사 한국과기산업	DATE	2020. 04.	SCALE	A3 = 1/20
CHECKED BY	-	DRAWING NO.	-	DRAWING TITLE	상명대학교바이오필터성능평가실 덕트설비
APPROVED BY	-	SHEET NO.	-		

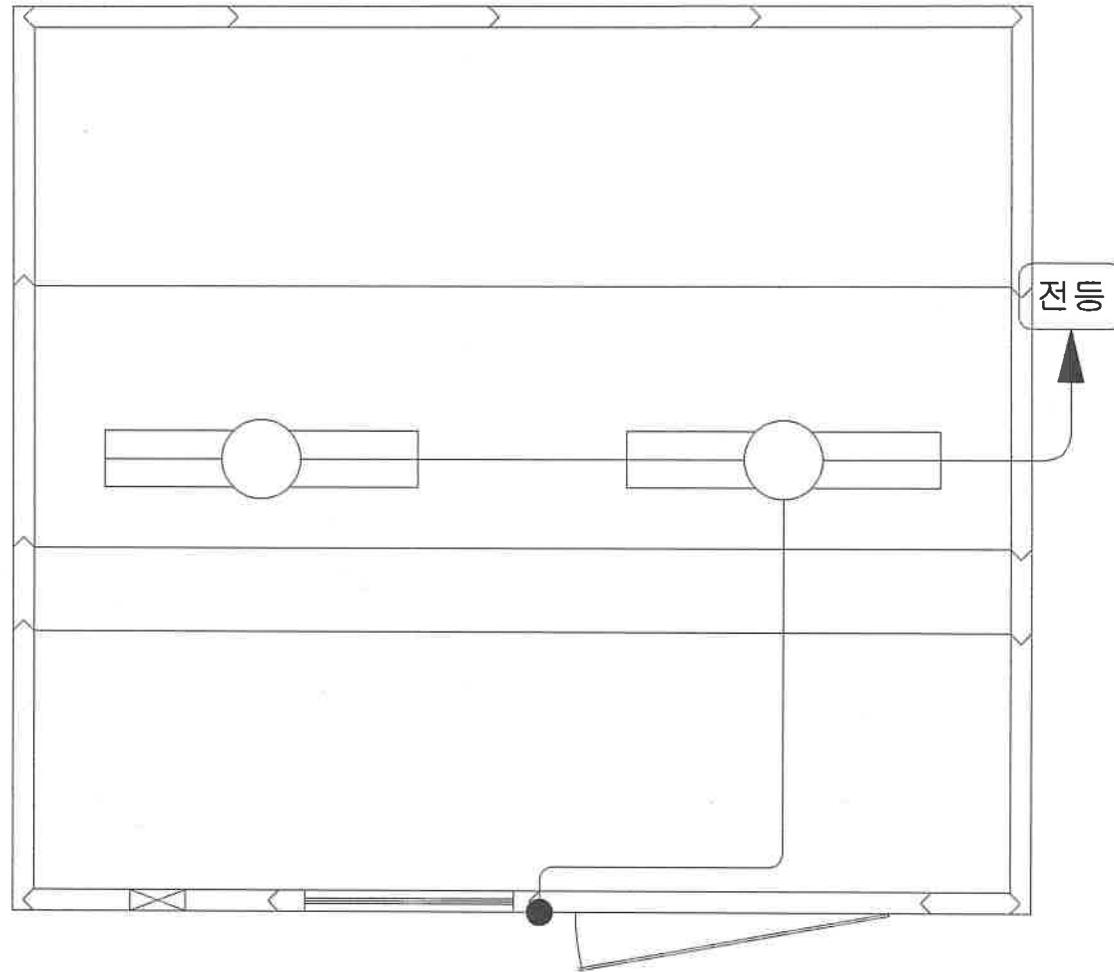


전등일람표

	LED 40W	설치수량:2개
		
MOUNT	LED유리구 - 알루미늄	
BODY/FRAME	STEEL / ALUMINIUM	1
COVER	외관	1
EMPS	AC 220V 60Hz ±5	1
LAMP	LED 40W	1
DESCRIPTION	MATERIAL/DETAIL	QTY REMARK



Korea Scientific Technique
Industry Co., Ltd.
TEL : +82-31-291-4055
FAX : +82-31-291-4066
EMAIL : gaooze@hanmail.net
HOMEPAGE : www.gaooze.com

DRAWING BY	주식회사 한국과기산업	DATE	2020. 04.	SCALE	A3 = 1/20
CHECKED BY	-	DRAWING NO.	-	DRAWING TITLE 상명대학교바이오필터성능평가실 전등설비	
APPROVED BY	-	SHEET NO.	-		

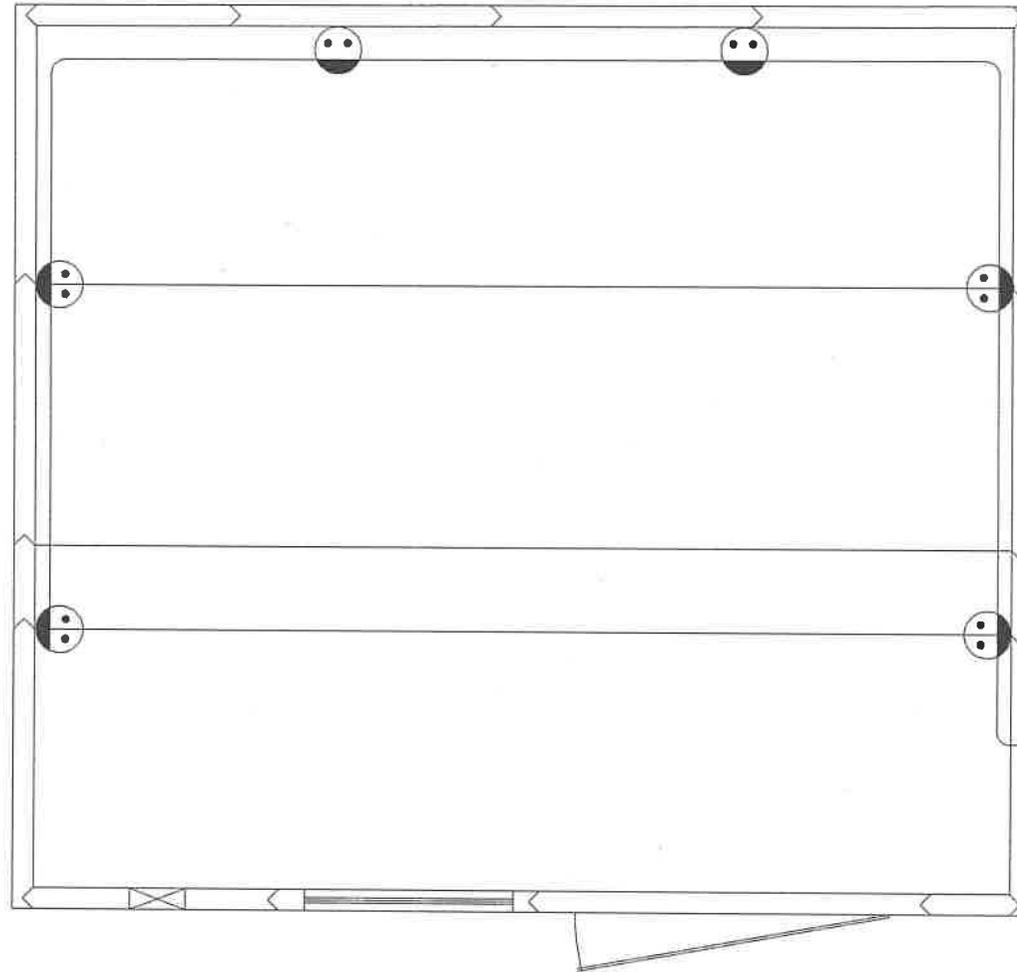

전열



Korea Scientific Technique
Industry Co., Ltd.
TEL : +82-31-291-4055
FAX : +82-31-291-4066
EMAIL : gaooze@hanmail.net
HOMEPAGE : www.gaooze.com

DRAWING BY	주식회사 한국과기산업	DATE	2020. 04.	SCALE	A3 = 1/20
CHECKED BY	-	DRAWING NO.	-	DRAWING TITLE 상명대학교바이오필터성능평가실 전열설비	
APPROVED BY	-	SHEET NO.	-		